

TENNESSEE WASTEWATER SYSTEMS, INC.
A PUBLIC UTILITY CO.

March 16, 2005

Honorable Pat Miller
Chairman
Tennessee Regulatory Authority
460 James Robertson Parkway
Nashville, TN 37243-0505


RECEIVED
2005 MAR 18 AM 8:09
T.R.A. DOCKET ROOM
05-00077

RE: Petition to amend Certificate of Convenience and Necessity

Dear Chairman Miller:

Tennessee Wastewater Systems, Inc. desires to expand its service area to include a portion of Maury County, Tennessee, known as Highway 50 Subway. The attached Petition is in support of our request.

Sincerely,



Charles Pickney, Jr., President
Tennessee Wastewater Systems, Inc.

7638 River Road Pike Nashville TN 37209-5733
(615) 356-2880 Fax (615) 356-7295

**BEFORE THE TENNESSEE REGULATORY AUTHORITY
NASHVILLE, TENNESSEE**

_____, 2005


**IN RE: PETITION OF TENNESSEE WASTEWATER SYSTEMS,
 INC. TO AMEND ITS CERTIFICATE OF
 CONVENIENCE AND NECESSITY**

DOCKET No. _____

Petition of Tennessee Wastewater Systems, Inc.
To amend its Certificate of Convenience and Necessity

Tennessee Wastewater Systems, Inc. ("TWS") petitions the Tennessee Regulatory Authority ("TRA") to amend TWS's Certificate of Convenience and Necessity to expand its service area to include a portion of Maury County known as Highway 50 Subway. (See proposed service area map Exhibits "A" & "B"). Attached is a letter from Ed Stevens expressing his desire for service. The City of Columbia, nor the Maury County Board of Public Utilities desires or has plans to provide sewer service to this area (See attached letters). The parcels encompass about 4 acres. The parcels are 27 and 28 Maury County Tax Map 144. This development will serve one commercial customer.

Respectfully submitted,



Charles Pickney Jr., President
Tennessee Wastewater Systems, Inc.

Kumar Patel
2302 Old Ridge Road
Huntsville, Alabama 35802

March 15, 2005

Tennessee Wastewater Systems, Inc.
Mr. Charles Pickney
7638 River Road Pike
Nashville, TN 37209

Re: Convenience Store
Exit 37 - I-65
Maury County, TN

Map 144 Parcels 27 & 28

Dear Mr. Pickney

This letter is to serve as a formal request for Tennessee Wastewater Systems, Inc. to provide service to the above referenced development in Maury County, Tennessee. Adequate soils do not exist on this property for septic systems to accommodate the proposed development. Since the City of Columbia, and Maury County do not provide sewer service to this area, we request that Wastewater Systems, Inc. provide this service.

Sincerely,


Kumar Patel

Ed Stevens
6413 Fischer Court
Brentwood, Tennessee 37027
615-943-7503 615-373-3368 (Fax)

To Whom It May Concern:

County Marion
The ~~City~~ of Marion will / will not provide sewer service to the property located
on Exit 37 + I-65, referred to in county tax maps as Map 144 Parcel(s) 27 + 28

Sincerely,

JP Hatch
JP Hatch
Director of Building & Zoning

Maury County Board of Public Utilities**Water System**

1018 South Garden Street
Columbia, Tennessee 38401
Office 931-381-8900 FAX 931-381-8288

January 28, 2005

Mr Ed Stevens
5413 Fischer Court
Brentwood, Tennessee 37027

Dear Mr. Stevens:

Maury County Board of Public Utilities presently does not service sewer in the County of Maury. To my knowledge, sewer is not available to the described property unless it would be a soil septic system. Currently potable water is available from Lewisburg Water & Wastewater. You might wish to contact Mr. Larry Jones, Superintendent of Lewisburg Water & Wastewater @ 931-359-6831 or mailing address is P. O. Box 2787 Lewisburg, Tennessee 37091.

If I can be of further assistance, please call the office.

Sincerely,



Larry Chunn, Superintendent
Maury County Water System

LTC/ld



Wastewater Treatment System

January 31, 2005

Mr. Ed Stevens
6413 Fischer Court
Brentwood, TN 37027

Re: Maury County Map 144 Parcels 27.00 and 28.

Dear Mr. Stevens:

The above referenced properties are not served by the City of Columbia Wastewater System. The wastewater system has no immediate plans to extend the sanitary sewer service area to include the listed above properties.


Sincerely,

Columbia Wastewater System

A handwritten signature in black ink, appearing to read "M. Glynn Anderson".

Michael Glynn Anderson, Director

EXHIBIT A

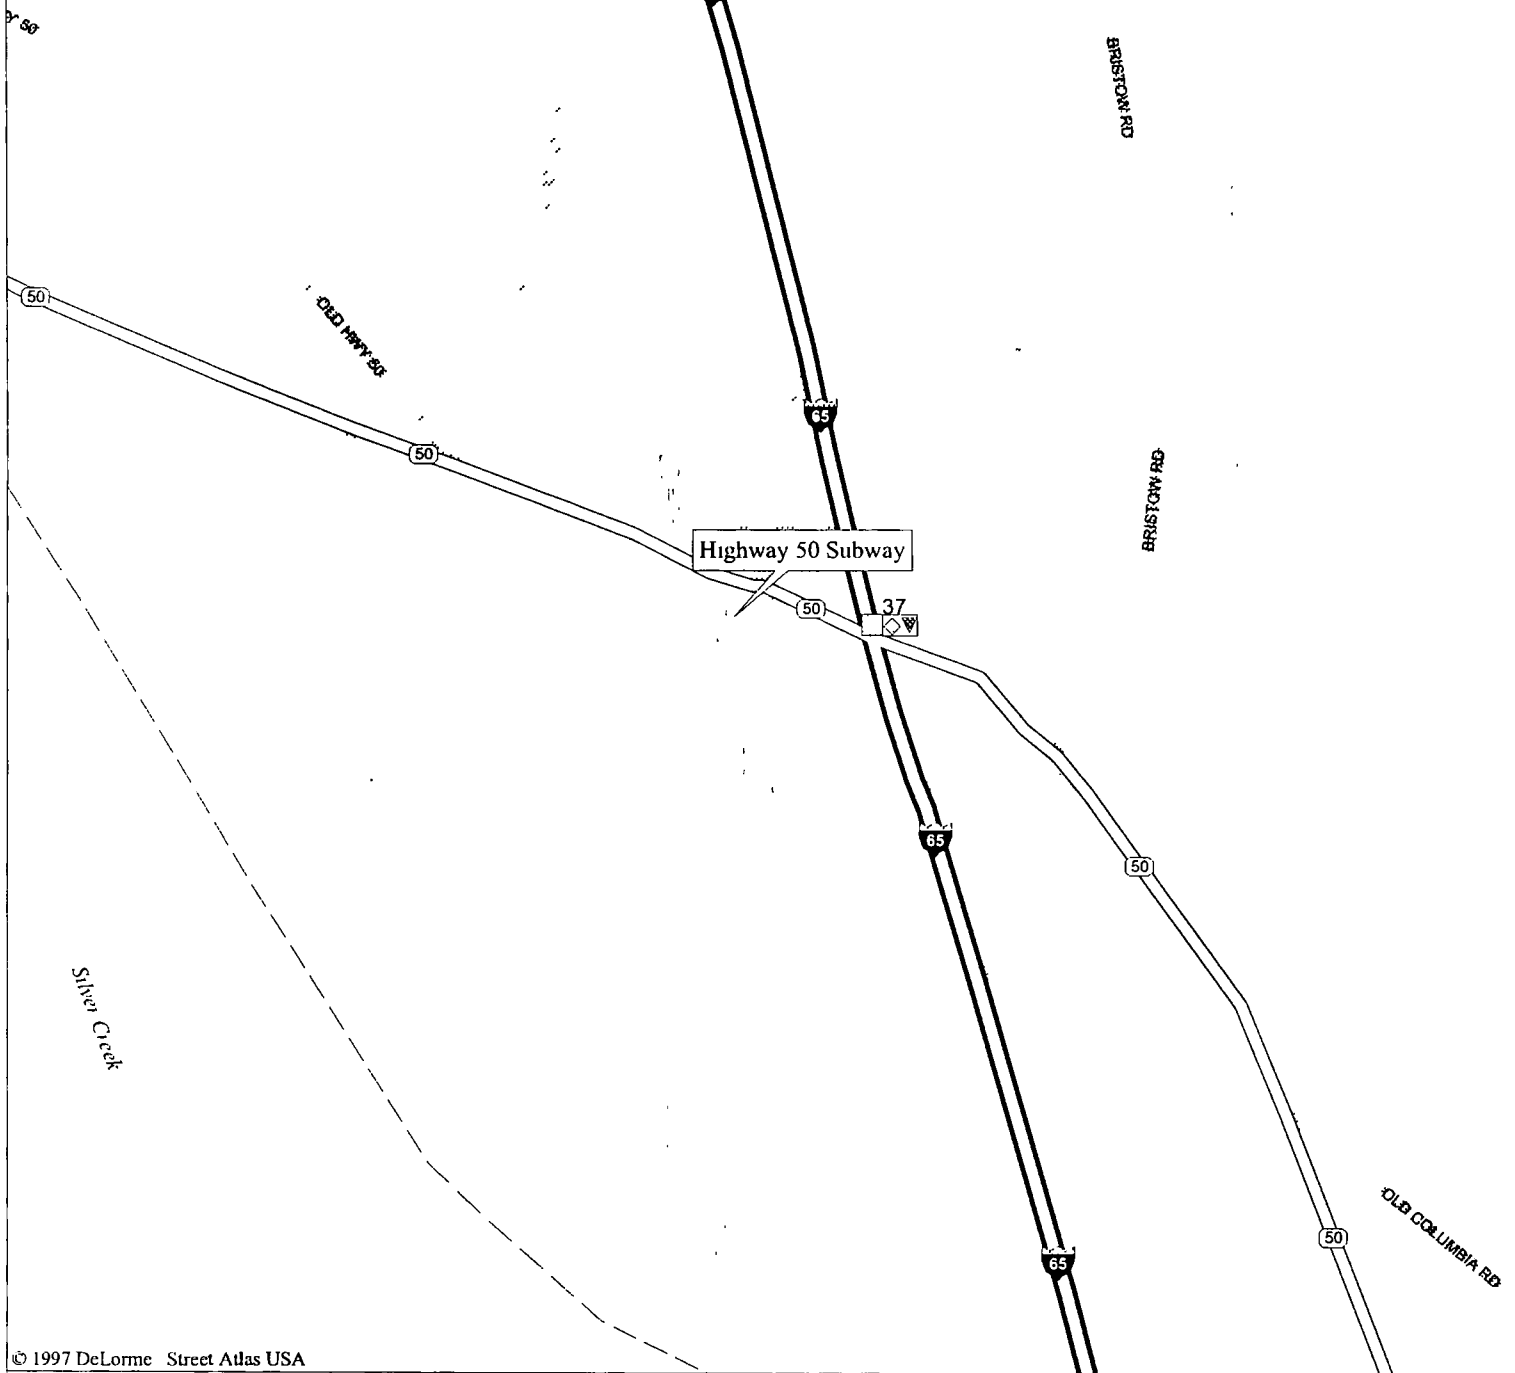

© 1997 DeLorme Street Atlas USA

Mag 16 00

Thu Mar 10 16 40 2005

Scale 1 7,812 (at center)

500 Feet




200 Meters



- Local Road
- Exit/Gas
- Exit/Lodging
- Interstate/Limited Access
- State Route
- Exit
- Utility/Pipe
- River/Canal

EXHIBIT B

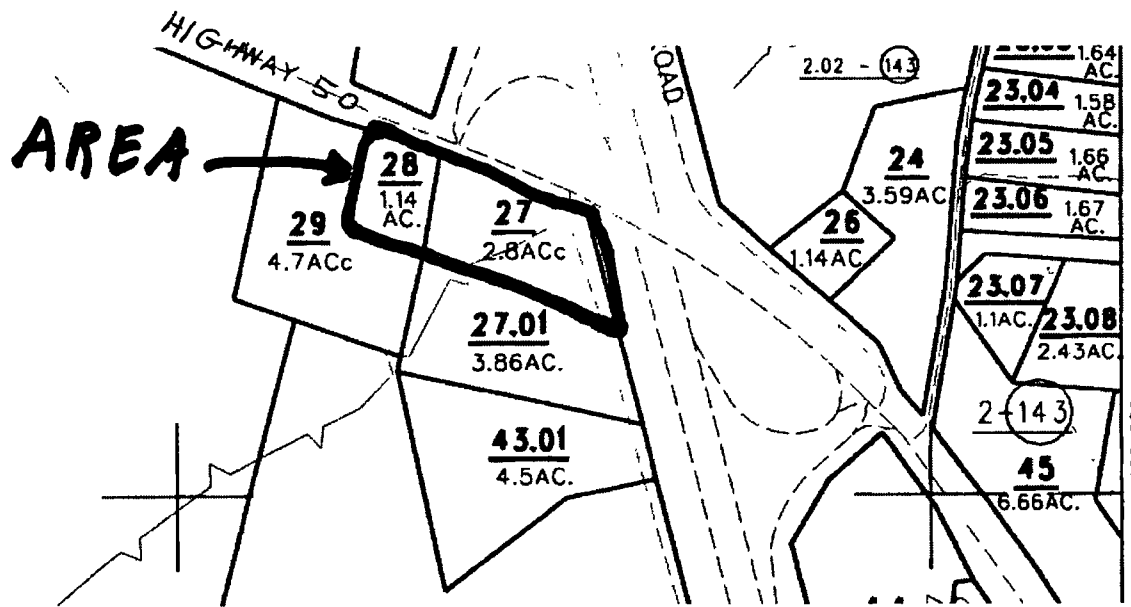

Tariff Rate Sheet

Commercial Sewer Rates – without food service

The monthly sewer charge per customer is based on the design daily flow expected from the type of establishment being served. A minimum of \$75 per month will be charged for up to the first 300 gallons per day of design flow expected. (Except off-site which will have a \$73.00 minimum plus pass through costs.) For each additional 100 gallons per day of design flow expected, up to a total of 1,000 gallons per day, an additional charge of \$15.00 per month per 100 gallons will be levied. For design flows expected over 1,000 gallons per day, up to 3,000 gallons per day, the following monthly charges per 1,000 gallons of daily flow will apply.

Disposal

<u>Treatment</u>	<u>Drip Irrigation</u>	<u>Point Discharge</u>	<u>Off Site</u>
<u>Sand-Gravel Filter</u>	\$140 00	\$165 00	N/A
<u>Lagoon</u>	\$116 00	\$140 00	N/A
<u>* Off Site</u>	N/A	N/A	Pass through costs & \$73 00

For design daily flows over 3,000 gallons, the monthly charge on all system configurations will be \$116.00 per 1000 gallons of daily flow.

Additional surcharges will apply when customers exceed their expected design flows. For any month that a customer's water meter reading exceeds the expected design flow, the following surcharges will apply:

Excess water usage	Surcharge
1 gallon to 1,000 gallons above expected design flow	\$175.00
1,001 gallons to 2,000 gallons above expected design flow	\$200.00
Over 2,000 gallons above expected design flow	\$200.00/1000 gallons

If the water meter readings exceed the design flow for any three consecutive months, the monthly charge will be revised to reflect the increased usage and any capital costs associated with increasing the capacity of the system will be paid by the customer.

* Off Site means treatment and disposal by another entity such as a city or utility district

Fees: Nonpayment – 5%
Disconnection - \$10
Reconnection - \$15
Returned Check - \$20
City of Coopertown Franchise Fees: 3%

Tariff Rate Sheet

Commercial Sewer Rates – with food service

The monthly sewer charge per customer is based on the design daily flow expected from the type of establishment being served. A minimum of \$100 per month will be charged for up to the first 300 gallons per day of design flow expected. (Except off-site which will have a \$94.00 minimum plus pass through costs.) For each additional 100 gallons per day of design flow expected, up to a total of 1,000 gallons per day, an additional charge of \$18.00 per month per 100 gallons will be levied. For design flows expected over 1,000 gallons per day, up to 3,000 gallons per day, the following monthly charges per 1,000 gallons of daily flow will apply.

Disposal

<u>Treatment</u>	<u>Drip Irrigation</u>	<u>Point Discharge</u>	<u>Off Site</u>
	<u>Sand-Gravel Filter</u>	\$170 00	\$192 00
	<u>Lagoon</u>	\$142 00	\$163 00
	<u>* Off Site</u>	N/A	N/A
			Pass through costs & \$94 00

For design daily flows over 3,000 gallons, the monthly charge on all system configurations will be \$142.00 per 1000 gallons of daily flow.

Additional surcharges will apply when customers exceed their expected design flows. For any month that a customer's water meter reading exceeds the expected design flow, the following surcharges will apply:

Excess water usage	Surcharge
1 gallon to 1,000 gallons above expected design flow	\$210.00
1,001 gallons to 2,000 gallons above expected design flow	\$220.00
Over 2,000 gallons above expected design flow	\$220.00/1000 gallons

If the water meter readings exceed the design flow for any three consecutive months, the monthly charge will be revised to reflect the increased usage and any capital costs associated with increasing the capacity of the system will be paid by the customer.

* Off Site means treatment and disposal by another entity such as a city or utility district

Fees: Nonpayment – 5%
Disconnection - \$10
Reconnection - \$15
Returned Check - \$20
City of Coopertown Franchise Fees: 3%

**Tennessee Wastewater Systems, Inc.
Sewer Systems with Commercial Customers**

System	County
Townsend Town Square – 99-00659	Blount County
Coopertown - 00-01128	Robertson County
East Stewart – 01-00229	Stewart County
Highway 31 Project (Herndon's BP) - 01-00446	Robertson County
Lyles Texaco - 01-00756	Hickman County
Topside Business Park – 01-00220	Blount County
Stewart County West - 02-00477	Stewart County
Cedar Hill Baptist Church – 03-00287	Robertson County
Tims Ford Area – 03-00286	Franklin County
Sunnybrook - 03-00307	Robertson County
Sevier County - 03-00045	Sevier County
Smoky Cove Subdivision – 03-00377	Sevier County
King Branch Road – 03-00386	Sevier County
Weigel's Convenience Store – 03-00519	Roane County
Paris Landing Area – 03-00544	Henry County
Turner's Landing – 04-00053	Hamblen County
Spring Creek Ranch – 04-00123	Shelby County
Marion Womack Property (Creekview Estates) – 04-00170	Sumner County
Arbor Crest Subdivision – 04-00171	Davidson County
Merril Taylor Subdivision - 04-00274	Blount County
Black Bear Ridge Expansion – 04-00045	Sevier County

**Tennessee Wastewater Systems, Inc.
Sewer Systems with Commercial Customers**

System	County
Legacy Laurel Branch - 04-00045	Sevier County
Legacy Mountain – 04-00045	Sevier County
Legacy the Preserves – 04-00045	Sevier County
Starr Crest II Phase 4 – 04-00045	Sevier County
Timber Tops Rental Center – 04-00045	Sevier County
Trailhead – 04-00045	Sevier County
Wyndsong Subdivision – 04-00395	Blount County
Huffines Development – 04-00393	Robertson County
Williamson County West - 04-00394	Williamson County
Trillium Cove Condominiums (Pending)	Blount County
Tennessee State Bank-Wears Valley Branch (Pending)	Sevier County
Highway 50 Subway	Maury County